

# CERTIFICATE OF ANALYSIS



Customer:

Batch #:


Report Issue Date:

Laboratory Number:

Order Date:

Analysis Date:

Sample Description:

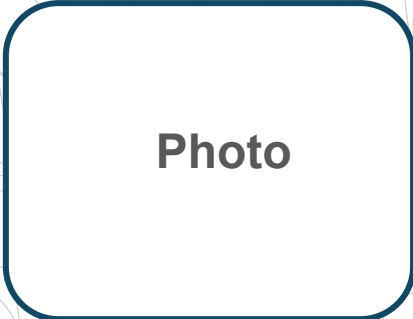

Extraction Technician: LL

Analytical Chemist: LL

Unit Weight:

*Hernan Prieto*

Laboratory Manager

## CANNABINOID PROFILE

| Analyte | LOQ (mg/g) | Results | % |
|---------|------------|---------|---|
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |

| Analyte | LOQ (mg/g) | Results | % |
|---------|------------|---------|---|
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |

| Analyte | LOQ (mg/g) | Results | % |
|---------|------------|---------|---|
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |
|         |            |         |   |

Max Active THC

Total Active Cannabinoids

Max Active CBD

Total Cannabinoids

## NOTES

Cannabidivarinic Acid(CBDVA) Cannabidivarin(CBDV) Cannabidiolic Acid(CBDA) Cannabigerolic Acid(CBGA) Cannabigerol(CBG) Cannabidiol(CBD)  
 Tetrahydrocannabivarin(THCV) Tetrahydrocannabivarinic Acid(THCVA) Cannabinol(CBN) Delta-9- Tetrahydrocannabinol(D9-THC) Delta-8-Tetrahydrocannabinol(D8-THC)  
 9S-Delta-10- Tetrahydrocannabinol(9S-D10-THC) 9R-Delta-10-Tetrahydrocannabinol(9R-D10-THC) 9S-Hexahydrocannabinol(9S-HHC) 9R-Hexahydrocannabinol(9R-HHC)  
 Cannabichromene(CBC) Cannabichromenic Acid(CBCA) Tetrahydrocannabinolic Acid(THCA) Delta-9-Tetrahydrocannabinophorol(D9-THCP) Delta-8- Tetrahydrocannabinol-O-Acetate (D8-THCO)



Reporting Limits will vary based on sample extraction weight used for the analysis. Accurate Test Lab, LLC utilizes based upon traceable Reference Standards and Certified Reference Material to calibrate analytical instruments along with proven analytical methods. The methods are applied in the most ethical manner following good laboratory practice guidelines. The results of this report are based solely on the sample submitted and cannot be reproduced. Results only apply to samples within COA as received.

Certificate of Analysis shall not be reproduce except in full without approval of Accurate Test Lab, LLC.

N/D: Not Detected LOQ: Limit of quantification

Analysis Method: ATL-LCM-001. Accurate Test Lab estimated expanded uncertainty is 13% as per in VALIDATION AND VERIFICATION OF ATL-LCM-001 (ATL-500A)

# CERTIFICATE OF ANALYSIS



Customer:

Batch #:

Report Issue Date:

Laboratory Number:

Order Date:


Analysis Date:

Sample Description:

Extraction Technician: HP

Analytical Chemist: HP

Unit Weight:

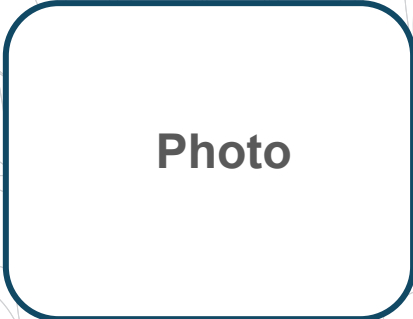

*Hernan Prieto*

Laboratory Manager

## RESIDUAL SOLVENTS PROFILE

| Analyte | Concentration<br>(PPM) | Action Limit<br>(PPM) | PASS/FAIL |
|---------|------------------------|-----------------------|-----------|
|---------|------------------------|-----------------------|-----------|

|  |  |  |  |
|--|--|--|--|
|  |  |  |  |
|--|--|--|--|

NOTES



Reporting Limits will vary based on sample extraction weight used for the analysis. Accurate Test Lab, LLC utilizes based upon traceable Reference Standards and Certified Reference Material to calibrate analytical instruments along with proven analytical methods. The methods are applied in the most ethical manner following good laboratory practice guidelines. The results of this report are based solely on the sample submitted and cannot be reproduced. Results only apply to samples within COA as received. Certificate of Analysis shall not be reproduce except in full without approval of Accurate Test Lab, LLC.

N/D: Not Detected LOQ: Limit of quantification

Analysis Method: ATL-GCM-001

1-Pass/Fail statement is based on California Code of Regulations, Title 16, Section 5718. Accurate Test Lab estimated expanded uncertainty is 25%, Following NIST, EURACHEM & CITAC guidelines.

info@accuratetestlab.com

(954) 515 - 0200

# CERTIFICATE OF ANALYSIS



Customer:

Batch #:

Laboratory Number:

Report Issue Date:

Order Date:

Analysis Date:

Sample Description:

Extraction Technician: HP

Analytical Chemist: HP

Unit Weight:



*Hernan Prieto*

Laboratory Manager

## PESTICIDES PROFILE

| Analyte | RESULT | PASS/FAIL | Analyte | RESULT | PASS/FAIL | Analyte | RESULT | PASS/FAIL |
|---------|--------|-----------|---------|--------|-----------|---------|--------|-----------|
|---------|--------|-----------|---------|--------|-----------|---------|--------|-----------|

|  |  |  |  |  |  |  |  |  |
|--|--|--|--|--|--|--|--|--|
|  |  |  |  |  |  |  |  |  |
|--|--|--|--|--|--|--|--|--|

NOTES



Reporting Limits will vary based on sample extraction weight used for the analysis. Accurate Test Lab, LLC utilizes based upon traceable Reference Standards and Certified Reference Material to calibrate analytical instruments along with proven analytical methods. The methods are applied in the most ethical manner following good laboratory practice guidelines. The results of this report are based solely on the sample submitted and cannot be reproduced. Results only apply to samples within COA as received. Certificate of Analysis shall not be reproduce except in full without approval of Accurate Test Lab, LLC. N/D: Not Detected T:Trace Cannabinoids detected but are below limit of quantification.

# CERTIFICATE OF ANALYSIS



Customer:

Batch #:

Laboratory Number:

Report Issue Date:

Order Date:


Analysis Date:

Sample Description:

Extraction Technician: HP

Analytical Chemist: HP

Unit Weight:

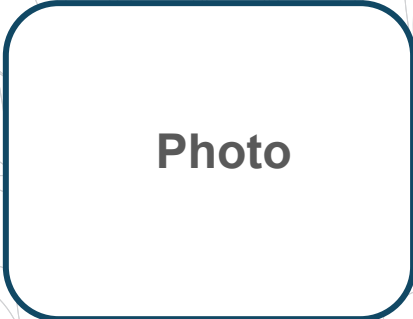

*Hernan Prieto*

Laboratory Manager

## FILTH & FOREIGN MATERIALS PROFILE

| Filth & Foreign Materials | % Detected by Weight | Allowable Criteria | PASS / FAIL |
|---------------------------|----------------------|--------------------|-------------|
|---------------------------|----------------------|--------------------|-------------|

|  |  |  |  |
|--|--|--|--|
|  |  |  |  |
|  |  |  |  |
|  |  |  |  |
|  |  |  |  |
|  |  |  |  |
|  |  |  |  |
|  |  |  |  |
|  |  |  |  |
|  |  |  |  |
|  |  |  |  |

NOTES



# CERTIFICATE OF ANALYSIS



Customer:

Batch #:

Laboratory Number:

Report Issue Date:

Order Date:


Analysis Date:

Sample Description:

Extraction Technician: HP

Analytical Chemist: HP

Unit Weight:

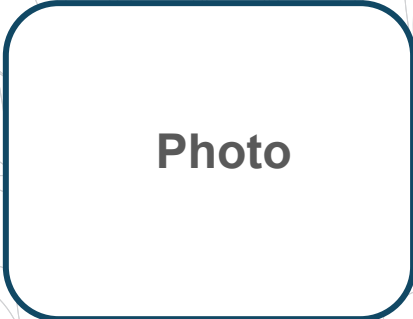

*Hernan Prieto*

Laboratory Manager

## MICROBIOLOGY ANALYSIS

| Microbe(s) | CFU Detected | Limit of Detection (CFU/g) | CFU/g | PASS / FAIL |
|------------|--------------|----------------------------|-------|-------------|
|            |              |                            |       |             |
|            |              |                            |       |             |
|            |              |                            |       |             |
|            |              |                            |       |             |

**NOTES**



Reporting Limits will vary based on sample extraction weight used for the analysis. Accurate Test Lab, LLC utilizes based upon traceable Reference Standards and Certified Reference Material to calibrate analytical instruments along with proven analytical methods. The methods are applied in the most ethical manner following good laboratory practice guidelines. The results of this report are based solely on the sample submitted and cannot be reproduced. Results only apply to samples within COA as received. Certificate of Analysis shall not be reproduce except in full without approval of Accurate Test Lab, LLC.  
TNTC: Too numerous to count - ND: Not Detected - NA: NotApplicable -CFU: Colony-forming unit 1-Pass/Fail criteria based on CMTL sample testing Florida Department of Health Emergency Rule for 2020, Pass: Results within limits /specifications, Fail: Results exceed limits/specifications Accurate Test Lab estimated expanded uncertainty(CFU/g):-Aerobic Plate Count:10 -Staphylococcus Aureus:4 - Yeast:4 - Mold:2 - Enterobacteriaceae:6. Analysis Method: ATL-PHI-002